

Gateshead Quays

Environmental Statement (April 2020)

Volume 2


Appendices to Chapter K - Water Resources and Flood Risk

Appendix K1 Utilities Map

A large, empty rectangular box intended for the Utilities Map.

Appendix K1

Utilities Map

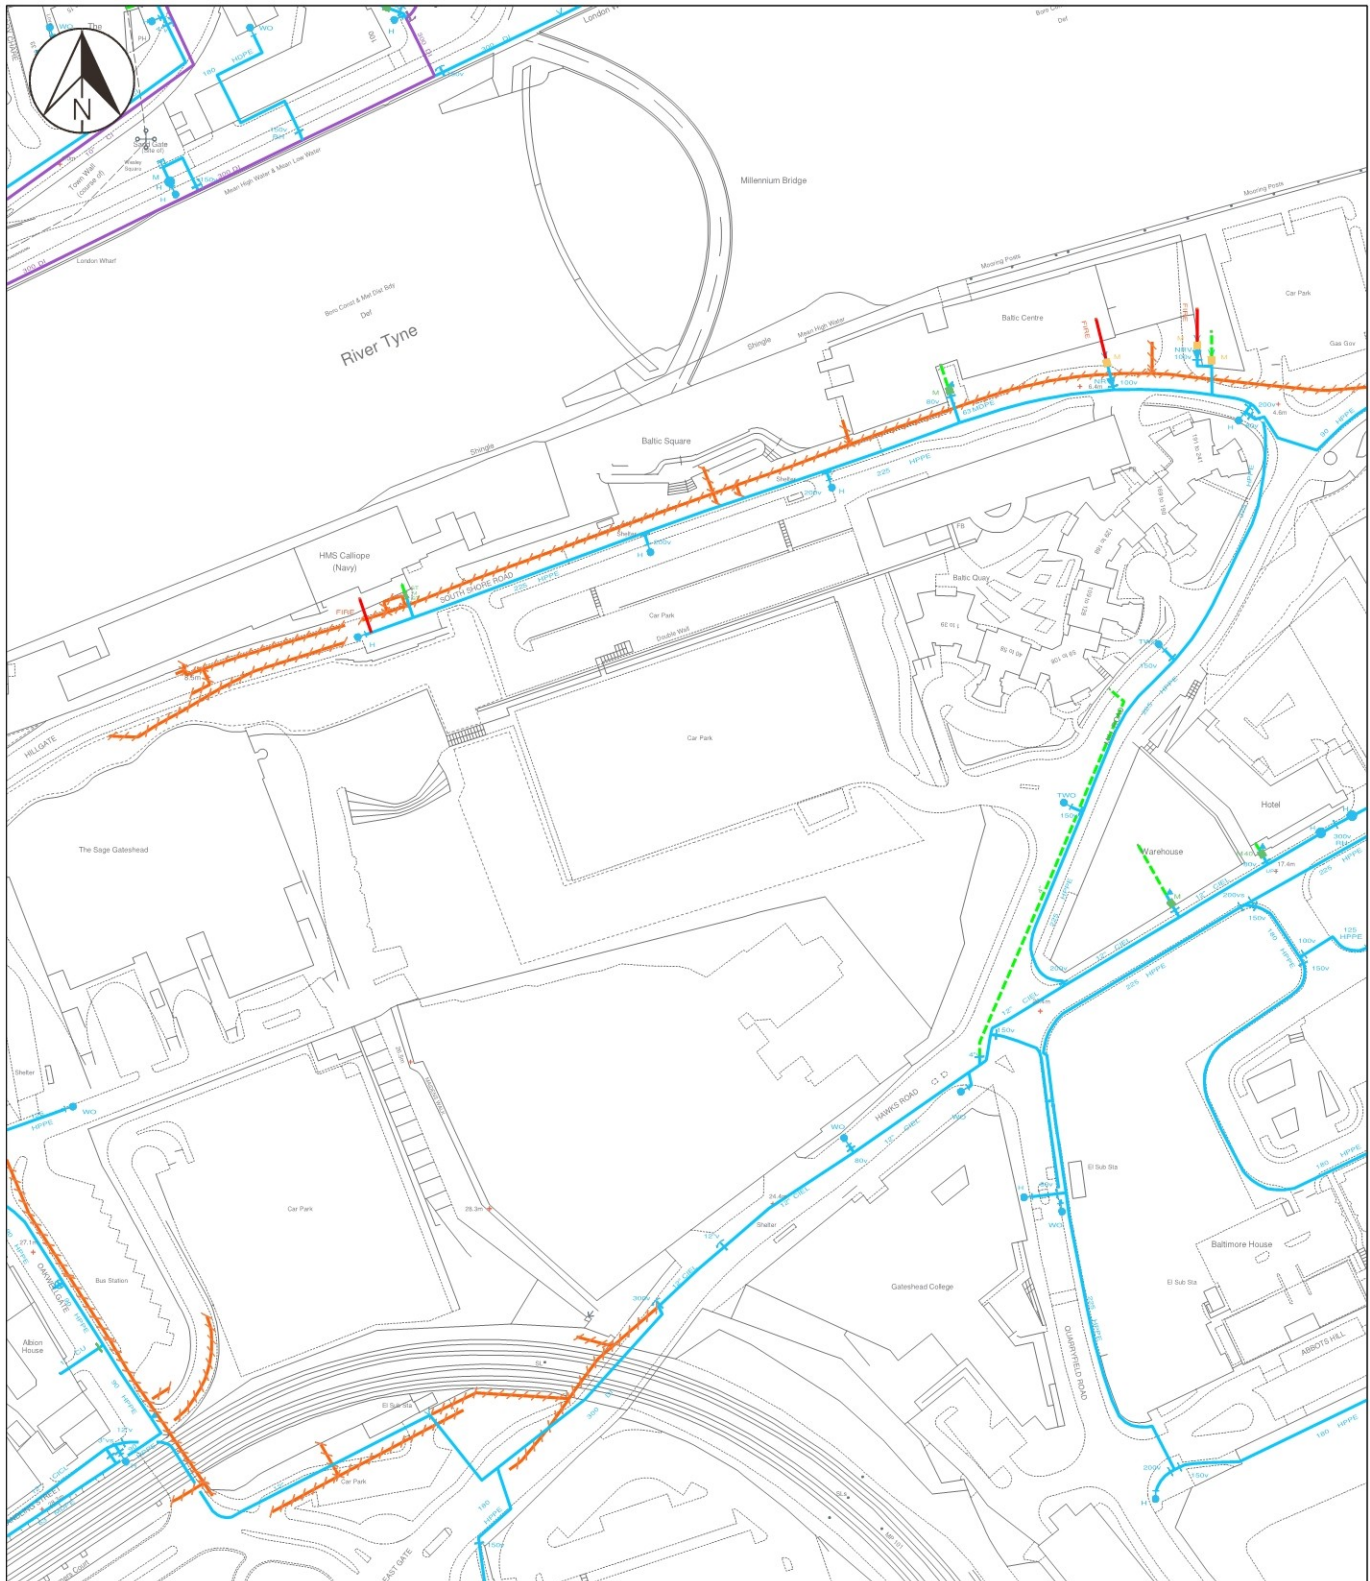

Valves/Regulators	Fittings/Symbols	Storage/Operations	Network Types	Specific Main Types	Area Types
P1 P2 P3 P4	 	 	Distribution Treated Raw Fire Supply	Abandoned Asbestos Abandoned Out of Commission Private	Water Quality District Metering Easement

NORTHUMBRIAN
WATER *living water*

User : DAWSJ1

Title : 0000

Centre Point : 425751,563775

Date : 19/10/2017 11:56:07


Map Sheet : NZ2563NE

Paper / Scale : A4@1:2500

The material contained on this plot has been reproduced from an Ordnance Survey map with permission of the controller of H.M.S.O. Crown Copyright Reserved. Licence No. 100022480. The information shown on this plan should be regarded as approximate and is intended for guidance only. No Liability of any kind whatsoever is accepted by Northumbrian Water. It's servants or agents for any omission. The actual position of any water mains or sewers shown on the plan must be established by taking trial holes in all cases. In the case of water mains Northumbrian Water must be given two working days notice of their intention to excavate trial holes. With effect from 1 October 2011, private lateral drains and sewers automatically transferred to Northumbrian Water under a scheme made by the Secretary of State pursuant to section 105A Water Industry Act 1991. These former private drains and sewers together with existing private connections may not be shown but their presence should be anticipated. WARNING...Where indicated on the plan there could be abandoned asbestos cement materials or shards of pipe. If excavating in the vicinity of these abandoned asbestos cement materials, the appropriate Health & Safety precautions should be taken. Northumbrian Water accepts no liability in respect of claims, costs, losses or other liabilities which arise as the result of the presence of the pipes or any failure to take adequate precautions. Emergency Telephone Number: 0345 717 1100

25 m



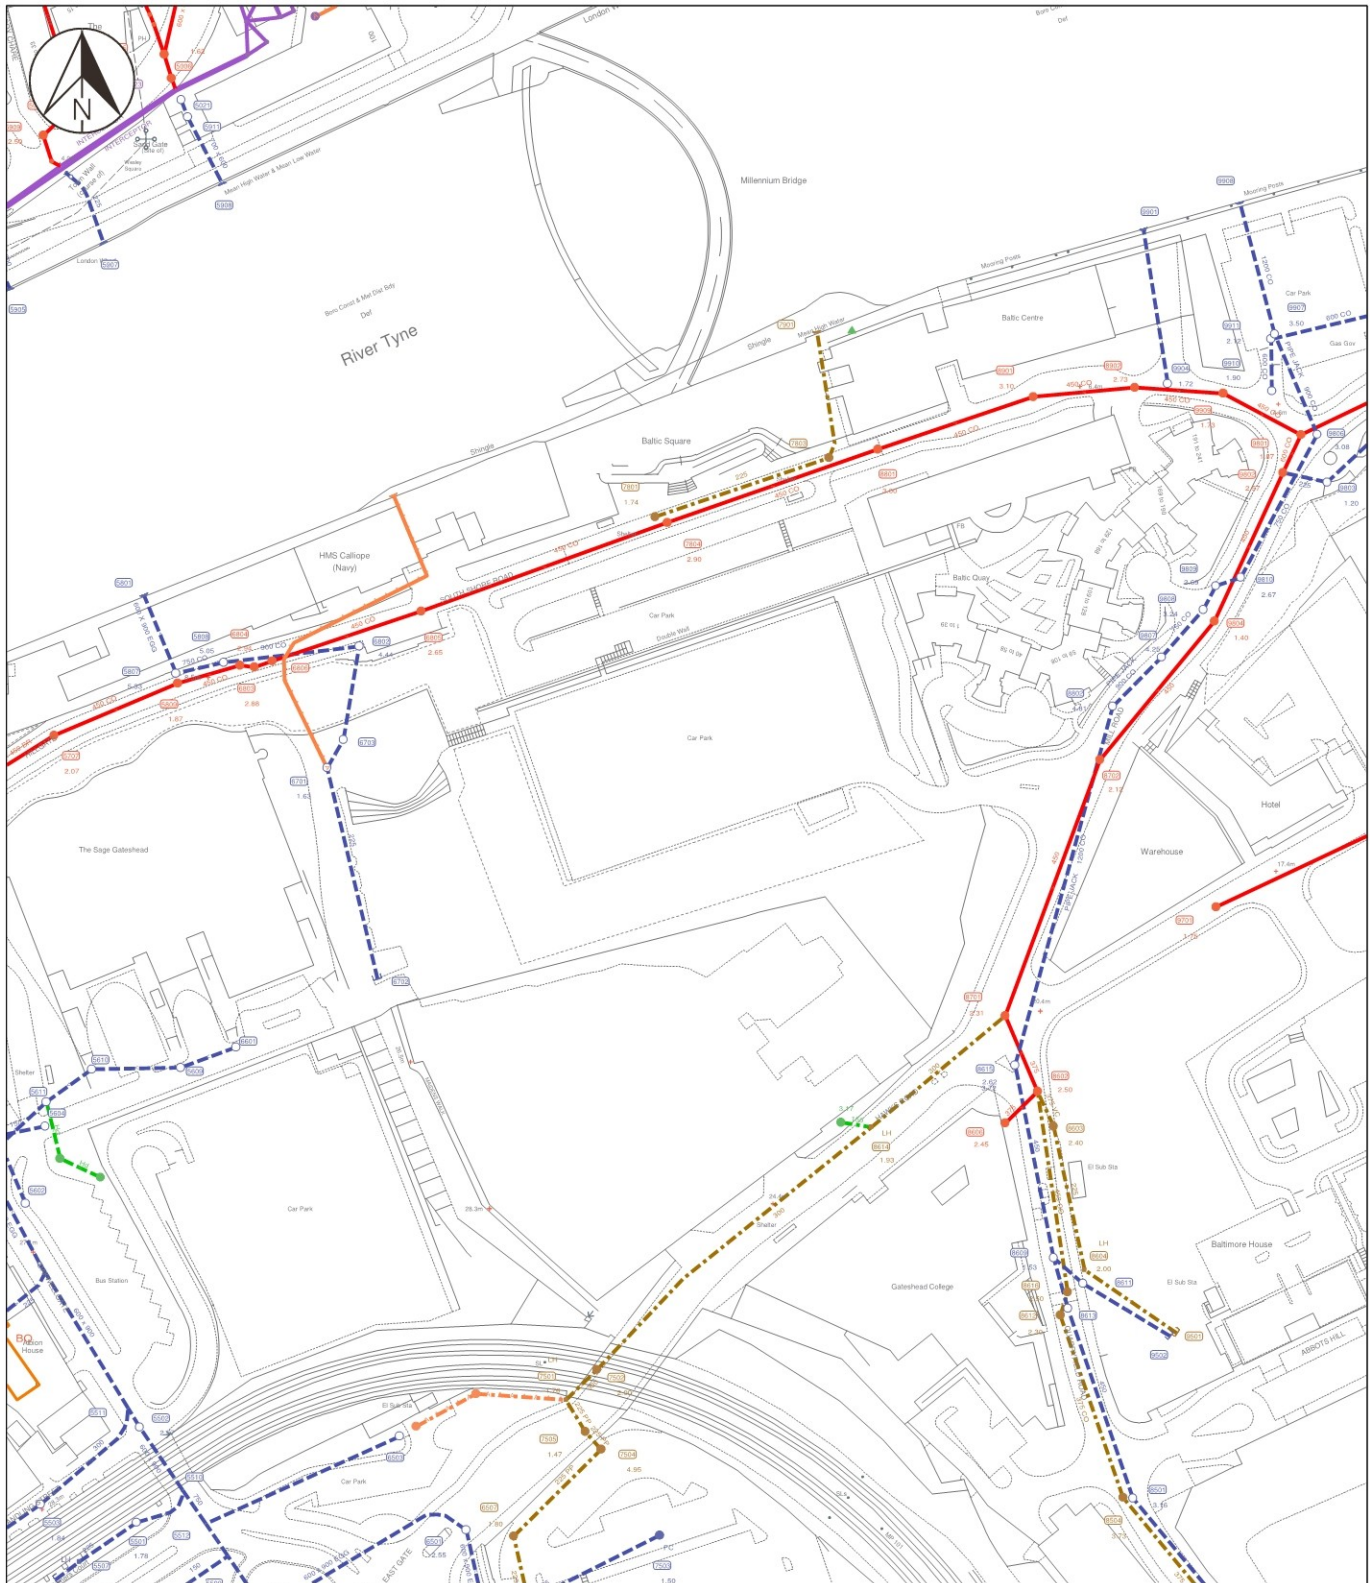

NWL Responsibility		Private/Non NWL		Proposed		Annotations		Symbols	
Combined	—	Combined	—	Combined	—	Direction of flow	→	Chambers	●
Foul	—	Foul	—	Foul	—	Backdrop	⬮	Inlet/Outlet	⌋
Surface	—	Surface	—	Surface	—	Abandoned	—	Treatment Works	STW
Treated Eff	—	Trade Eff	—	Surface	—	Rising Main	—	Capped End	⌋
Untreated Eff	—	Watercourse	—					Termination Node	▶
Overflow	—							Rodding Eye	⬮



User : DAWSJ1

Title : 0000

Centre Point : 425751,563775

Date : 19/10/2017 11:56:44

Map Sheet : NZ2563NE

Paper / Scale : A4@1:2500

The material contained on this plot has been reproduced from an Ordnance Survey map with permission of the controller of H.M.S.O. Crown Copyright Reserved. Licence No. 100022480. The information shown on this plan should be regarded as approximate and is intended for guidance only. No Liability of any kind whatsoever is accepted by Northumbrian Water, its servants or agents for any omission. The actual position of any water mains or sewers shown on the plan must be established by taking trial holes in all cases. In the case of water mains Northumbrian Water must be given two working days notice of their intention to excavate trial holes. With effect from 1 October 2011, private lateral drains and sewers automatically transferred to Northumbrian Water under a scheme made by the Secretary of State pursuant to section 105A Water Industry Act 1991. These former private drains and sewers together with existing private connections may not be shown but their presence should be anticipated. WARNING...Where indicated on the plan there could be abandoned asbestos cement materials or shards of pipe. If excavating in the vicinity of these abandoned asbestos cement materials, the appropriate Health & Safety precautions should be taken. Northumbrian Water accepts no liability in respect of claims, costs, losses or other liabilities which arise as the result of the presence of the pipes or any failure to take adequate precautions. Emergency Telephone Number: 0345 717 1100

